


**Data Sheet | Item Number: 2273-202**

PUSH WIRE® splicing connector; for solid conductors; max. 2.5 mm²; 2-conductor;  
transparent housing; white cover; Surrounding air temperature: max 60°C (T60);  
2,50 mm²; transparent

<https://www.wago.com/2273-202>



Color: ☐ transparent

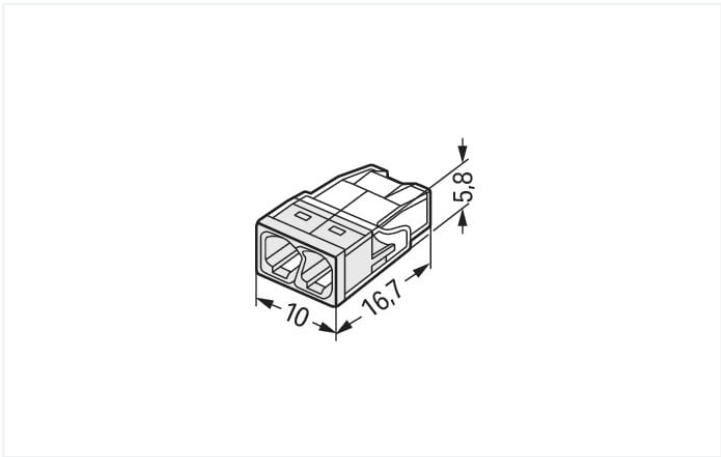

Dimensions in mm

**Advantages:**

- Convenient wiring via extremely compact design
- Push-in termination of up to eight solid conductors
- Cross-section range: 0.5 ... 2.5 mm²
- Any combination of conductor sizes is possible
- PUSH WIRE® connection terminates solid ("s") copper conductors

Notes	
Safety management note	<b>NOTICE: Observe installation and safety instructions!</b>
	<ul style="list-style-type: none"><li>• <b>Only to be used by electricians!</b></li><li>• Do not work under voltage/load!</li><li>• Use only for proper use!</li><li>• Observe national regulations/standards/guidelines!</li><li>• Observe technical specifications for the products!</li><li>• Observe the number of permissible potentials!</li><li>• Do not use damaged/dirty components!</li><li>• Observe conductor types, cross-sections and strip lengths!</li><li>• Insert conductor until it hits the product's backstop!</li><li>• Use original accessories!</li></ul>
	<b>To be sold only with installation instructions!</b>

Safety information

in grounded power lines



Electrical data						
Ratings per		IEC/EN 60998			Approvals per	
		UL 486C				
Overvoltage category	III	III	II		Use group	B C D
Pollution degree	3	2	2		Rated voltage	- - -
Nominal voltage	-	-	450 V		Rated current	- - -
Rated surge voltage	-	-	4 kV			
Rated current	-	-	24 A			

Connection data			
Connection points	2		
Total number of potentials	1		
		Connection 1	
		Connection technology	PUSH WIRE®
		Actuation type	Push-in
		Connectable conductor materials	Copper Aluminum
		Connectable conductor materials (note)	<b>Terminating Aluminum Conductors</b> WAGO spring clamp terminal blocks are suitable for solid aluminum conductors up to 4 mm²/12 AWG if WAGO "Alu-Plus" Contact Paste <a href="#">249-130</a> is used for termination.  "Alu-Plus" Contact Paste Advantages: <ul style="list-style-type: none"><li>• Automatically destroys the oxide film during clamping.</li><li>• Prevents fresh oxidation at the clamping point.</li><li>• Prevents electrolytic corrosion between aluminum and copper conductors (in the same terminal block).</li><li>• Provides long-term protection against corrosion.</li></ul> For spring clamp connections with PUSH WIRE® connection technology, <b>WAGO recommends that the aluminum conductor first be cleaned</b> and then immediately inserted into the clamping unit filled with "Alu-Plus" contact paste.  It is also possible to apply WAGO "Alu-Plus" <b>additionally</b> on the whole surface of the aluminum conductor before termination.  Please note that the nominal currents must be adapted to the reduced conductivity of the aluminum conductors: 2.5 mm² = 16 A 4 mm² = 22 A
		Solid conductor	0.5 ... 2.5 mm² / 20 ... 16 AWG
		Strip length	11 mm / 0.43 inches
		Wiring direction	Side-entry wiring

Physical data	
Width	10 mm / 0.394 inches
Height	5.8 mm / 0.228 inches
Depth	16.7 mm / 0.657 inches





Material data		
Note (material data)		<a href="#">Information on material specifications can be found here</a>
Color	transparent	
Cover color	white	
Material group	IIIa	
Insulation material	Polycarbonate (PC)	
Flammability class per UL94	V2	
Clamping spring material	Chrome-nickel spring steel (CrNi)	
Contact material	Electrolytic copper (E <sub>Cu</sub> )	
Contact plating	Tin	
Fire load	0.022 MJ	
Weight	0.7 g	

Environmental requirements		
Ambient temperature (operation)	+60 °C	
Continuous operating temperature	105 °C	
Temperature marking per EN 60998	T60	

Commercial data		
Product Group	7 (Push Wire Conn.)	
eCl@ss 10.0	27-14-11-04	
eCl@ss 9.0	27-14-11-04	
ETIM 8.0	EC000446	
ETIM 7.0	EC000446	
PU (SPU)	1000 (100) pcs	
Packaging type	Box	
Country of origin	DE	
GTIN	4050821027843	
Customs tariff number	85369010000	

Environmental Product Compliance		
RoHS Compliance Status	Compliant, No Exemption	

Approvals / Certificates		
General approvals		Declarations of conformity and manufacturer's declarations
 		
Approval	Standard	Certificate Name
cULus_Listed_667F Underwriters Laboratories Inc.	UL 486C	E69654
VDE VDE Prüf- und Zertifizie- rungsinstitut	EN 60998	40029794
Approval	Standard	Certificate Name
EU-Declaration of Confor- mity WAGO GmbH & Co. KG	-	-
UK-Declaration of Confor- mity WAGO GmbH & Co. KG	-	-



Approvals for marine applications



Approval	Standard	Certificate Name
ABS American Bureau of Ship- ping	-	15-HG1419918-PDA
DNV GL Det Norske Veritas, Ger- manischer Lloyd	EN 60998	TAE000015T
LR Lloyds Register	EN 60998	LR22207029TA

Downloads

Environmental Product Compliance

Compliance Search
Environmental Product Compliance 2273-202



Documentation

Bid Text			
2273-202	19.02.2019	xml 3.17 KB	
2273-202	17.05.2017	doc 24.50 KB	
ausschreiben.de 2273-202			

CAD/CAE-Data

CAD data
2D/3D Models 2273-202



CAE data
EPLAN Data Portal 2273-202
WSCAD Universe 2273-202
ZUKEN Portal 2273-202





1 Compatible Products

1.1 Optional Accessories

1.1.1 General accessories

1.1.1.1 Moisture protection



**Item No.: 207-1331**  
Gelbox; Branch; for cables; with gel; 221, 2x73 Series; max. 4 mm² connectors; without splicing connectors; Size 1; gray



**Item No.: 207-1332**  
Gelbox; Branch; for cables; with gel; 221, 2x73 Series; max. 4 mm² connectors; without splicing connectors; Size 2; gray



**Item No.: 207-1333**  
Gelbox; Branch; for cables; with gel; 221, 2x73 Series; max. 4 mm² connectors; without splicing connectors; Size 3; gray

1.1.2 Mounting adapter

1.1.2.1 Mounting accessories



**Item No.: 2273-500**  
Mounting carrier; for single- and double-row con.; 2273 Series; for DIN-35 rail mounting/screw mounting; orange

1.1.3 Tool

1.1.3.1 “Alu-Plus” contact paste



**Item No.: 249-130**  
Syringe; Contents: 20 ml Alu-Plus contact paste

Installation Notes


Conductor termination



Strip solid conductor to 11 mm/0.43 inch (see marking).



The transparent housing shows if conductors are fully inserted; within the colored base, a clear port shows if the conductor's strip length is correct. Conductors are correctly stripped if the clear port shows no bare conductor on the unprinted connector side. Picture shows center conductor with exceeded strip length.



Termination: Insert the stripped solid conductor until it hits the backstop.



Removal: Hold conductor to be removed and twist alternately left and right while pulling the connector.

Testing



Testing via test port opposite to conductor entry.